



AN ALTERNATE INSTALLATION MAY BE COMPRISED OF STANDARD DEPRESSED CURB THROUGH THE APPROACH WITH THE APPROACH ITSELF CONSTRUCTED OF FULL DEPTH ASPHALT (MINIMUM 4" - 301, 2" - 404) IF APPROVED BY THE ENGINEER.

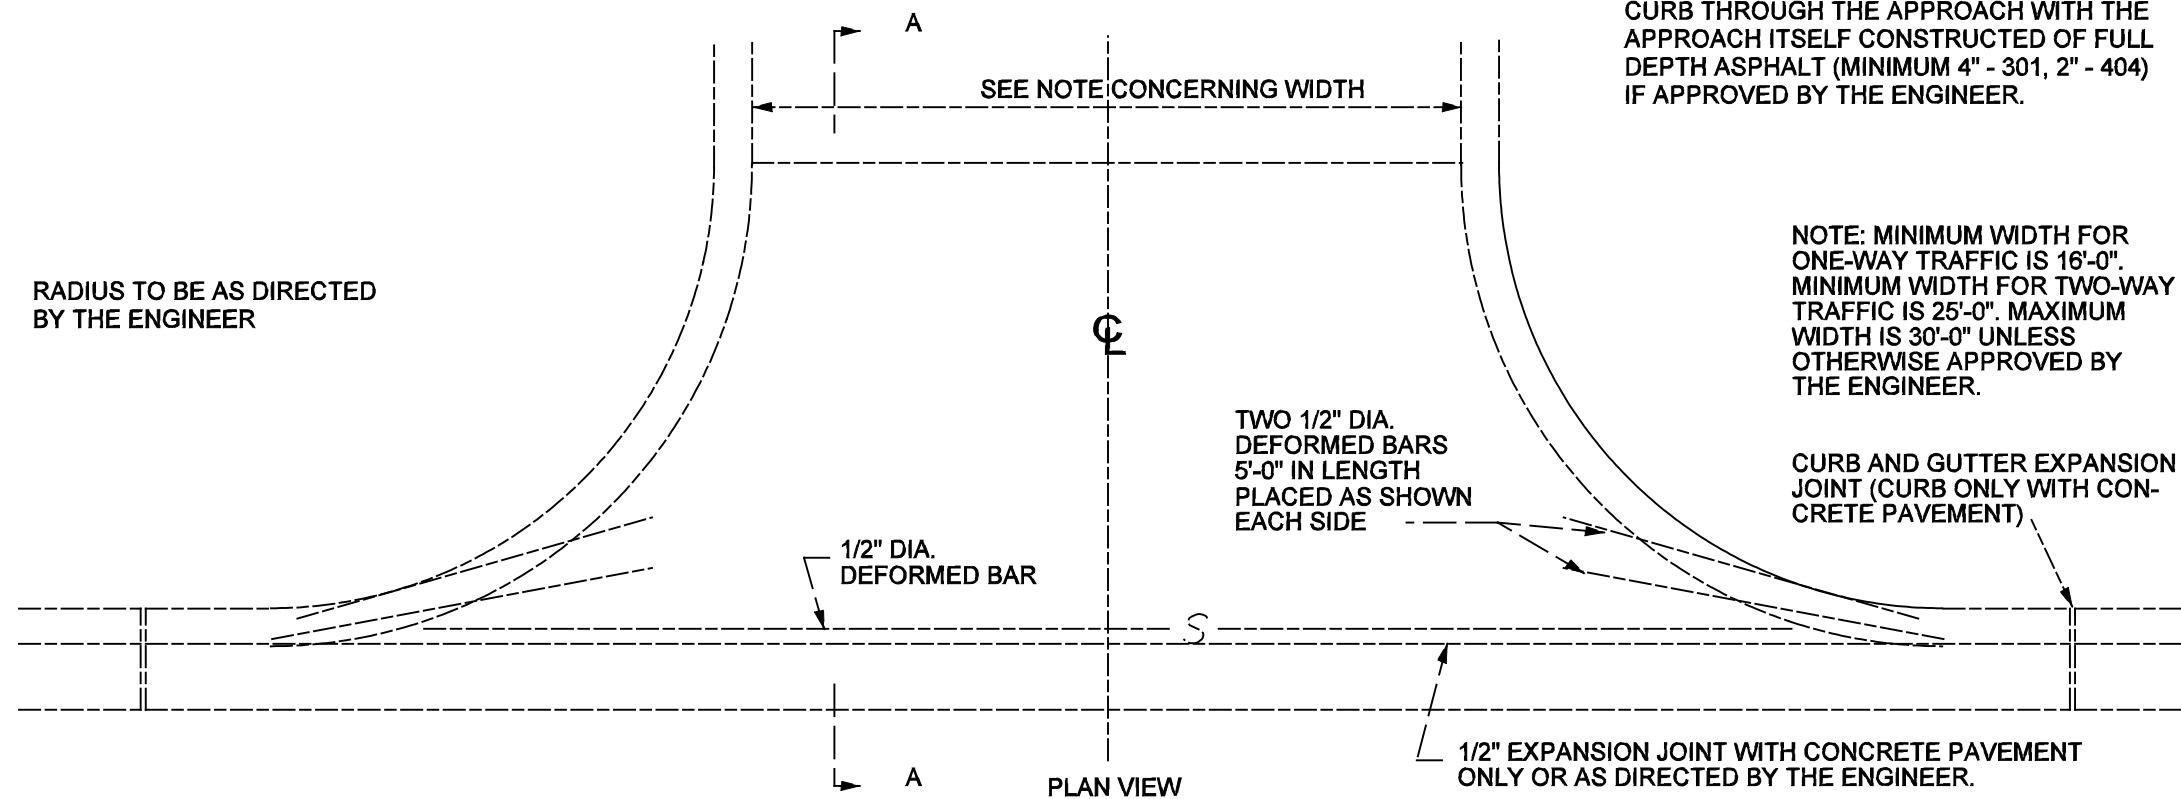

NOTE: MINIMUM WIDTH FOR ONE-WAY TRAFFIC IS 16'-0". MINIMUM WIDTH FOR TWO-WAY TRAFFIC IS 25'-0". MAXIMUM WIDTH IS 30'-0" UNLESS OTHERWISE APPROVED BY THE ENGINEER.

CURB AND GUTTER EXPANSION JOINT (CURB ONLY WITH CONCRETE PAVEMENT)

1/2" EXPANSION JOINT WITH CONCRETE PAVEMENT ONLY OR AS DIRECTED BY THE ENGINEER.

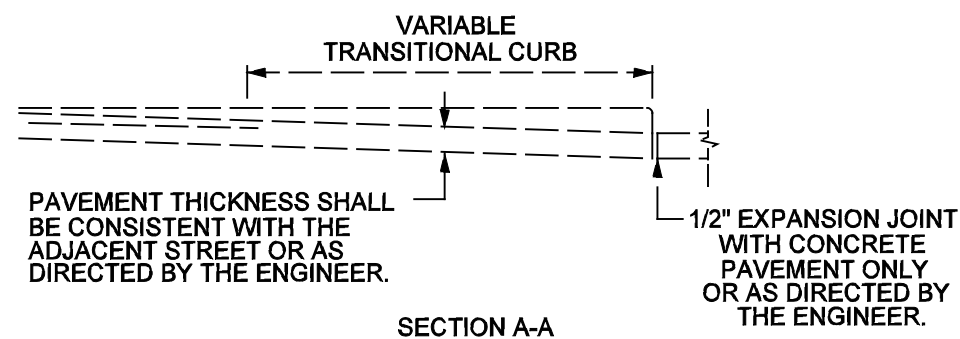

PAVEMENT THICKNESS SHALL BE CONSISTENT WITH THE ADJACENT STREET OR AS DIRECTED BY THE ENGINEER.

1/2" EXPANSION JOINT WITH CONCRETE PAVEMENT ONLY OR AS DIRECTED BY THE ENGINEER.

SECTION A-A

GENERAL NOTES

JOINTS SHALL BE CLEANED AND EDGED BY A 1/4" RADIUS EDGER. LONGITUDINAL JOINTS SHALL BE AS DIRECTED BY THE ENGINEER. EXPANSION JOINTS SHALL BE OF SUCH DIMENSIONS AS SHOWN ON STANDARD DRAWINGS FOR CONSTRUCTION JOINTS.

MATERIAL SHALL MEET THE REQUIREMENTS OF THESE SPECIFICATIONS.

THIS TYPE OF APPROACH MAY BE USED ONLY AS APPROVED BY THE ENGINEER IN AREAS WITHOUT SIDEWALKS.

4" OF ITEM 304 OR 411 GRAVEL SHALL BE PLACED UNDER DRIVE APPROACHES.