


PLAN VIEW


CALL 811 TWO BUSINESS
DAYS BEFORE YOU DIG

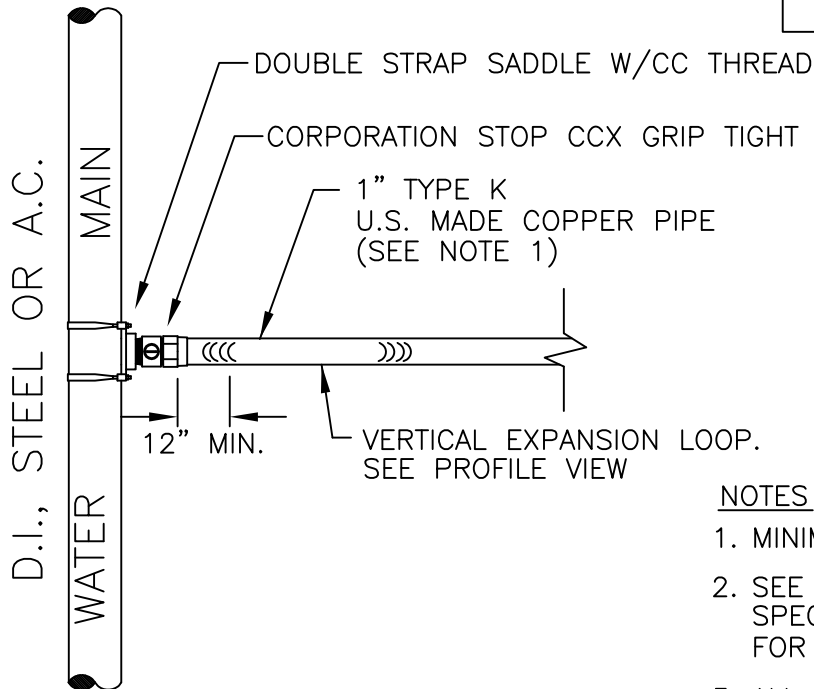

NOTES

1. MINIMUM SERVICE PIPE IS 1 INCH.
2. SEE SECTION 4-3 FOR MATERIAL SPECIFICATIONS AND DWG 4-31 FOR INSTALLATION REQUIREMENTS.
3. ALL BENDS TO BE A MINIMUM OF ONE FOOT FROM ALL SERVICE LINE FITTINGS.

PROFILE VIEW

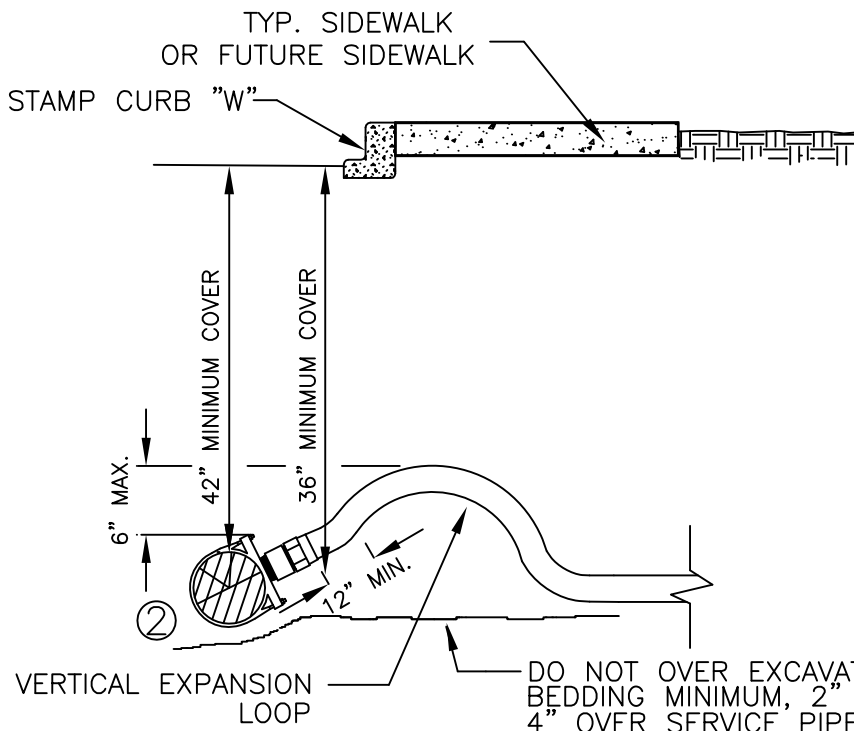

NOTES

1. TAP AT 1:00 OR 11:00 FOR D.I. STEEL OR A.C. MAINS SEE DWG 4-26 FOR SERVICE FROM PVC MAINS.

DETAILS FOR TAPPING D.I., STEEL & A.C. WATER MAINS



CITY OF
WEST RICHLAND

DRAWN BY: AFW
CHECKED BY: HLM

DATE: 8/06
REVISION: 8/09

4-28

DRAWING NO.