

REQUEST FOR QUOTATION

CITY OF WINTER HAVEN

" An Equal Opportunity Employer"

RFQ- - 11 - 87

Please return quote to:
 City of Winter Haven
 Procurement Service Division
 401 6th St SW
 Winter Haven, FL 33880

For additional information and clarification contact:
 Department Name: Utility Services

Bert DiBiasie
rdibiasie@mywinterhaven.com

Telephone #: 863-291-5853

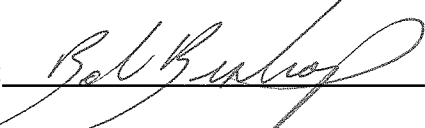
Fax #: 863-291-5886

DATE ISSUED: 8/29/2011

Please quote on the following items:

Item	Quantity	Description	Unit Price	Total Price
A	400 l/ft	12" HDPE DR11 DIPS Blue Stripe Pipe	\$	\$
B	200 l/ft	12" C900 Blue Water Pipe	\$	\$
C	20 ea	12" Mega Lugs & Kits	\$	\$
D	8 ea	12" MJ 45	\$	\$
E	7 ea	12" Bell Restraints	\$	\$
F	2 ea	12" HDPE Inserts	\$	\$
G	4 ea	12" X 2" MJ Caps	\$	\$
H	4 ea	Pre-cast Thrust Blocks	\$	\$
		all items must be domestic or meet attached spec's		
		Brands Bid _____		
		NOTE ----- * * ALL items must be delivered prior to Oct-3 * *		
			Grand Total	\$

Prices must be valid for 90 days.

Procurement Services Division Director: 

DELIVERY REQUIRED BEFORE OCTOBER 3, 2011

We offer to sell you as above F.O.B., Winter Haven, Florida.

Quotation must be received NO LATER THAN 2:00 P.M., September 12, 2011

at: Procurement Services Division, address above or FAX TO 863-291-5666

SIGNATURE: _____

DATE: _____

**COMPANY NAME: _____

ADDRESS: _____

CITY/STATE _____

PHONE: _____

FAX: _____

EMAIL: _____

****PAYMENT WILL BE RENDERED TO THE NAME AND ID APPEARING ON THE W-9.**

SPECIFICATIONS 03/03/11

Mega-Lug Restraints: Mega-Lug Restraint dimensions of the gland shall be such that it can be used with the standardized mechanical joint bell and tee-head bolts conforming to ANSI A21.11 and ANSI/AWWA C153/A21.53. Twist-off nuts shall be used to ensure proper actuating of the restraining devices.

Locating wire: 14 AWG, solid wire, 60-mils PVC insulator (insulating color per specification), UF, 500 feet per roll.

Mechanical Joint Fittings (MJ): ANSI specifications A21.10 (AWWA C110), A21.11 (AWWA C.111), and/or ANSI/AWWA C153/A21.53. Furnished with bituminous coating unless otherwise specified. Domestic, or Sigma, or Tyler/Union.

Bell Joint Restraints: Mechanical joint restraint shall include a restraining mechanism which, when actuated, imparts multiple or continuous wedging action against the pipe, increasing its resistance as the pressure increases. Flexibility of the joint shall be maintained after burial. Glands shall be manufactured of ductile iron conforming to ASTM A536. For "Mega-Lug" restraints, dimensions of the gland shall be such that it can be used with the standardized mechanical joint bell and tee-head bolts conforming to ANSI A21.11 and ANSI/AWWA C153/A21.53. Twist-off nuts shall be used to ensure proper actuating of the restraining devices. Domestic mfg, or Star, Tyler Forge, Taylor Forge, or Sigma brands.